

data

SHEET



BASremote — Versatile BACnet/IP Controller/Gateway

The BASremote series provide the system integrator a flexible building block when integrating diverse building automation protocols or when expanding the number of points in a building automation system. By supporting open system protocols such as BACnet®, Modbus and Sedona Framework™ SOX,

the BASremote series is easily adaptable. For small systems, it can operate stand-alone. For larger systems, it can communicate to supervisory controllers over Ethernet. Depending upon the model, the BASremote has the flexibility to provide the following:

Versatile Control Device — remote I/O, router, gateway and controller

- Web-page configuration
- BACnet/IP remote I/O
- Modbus TCP remote I/O
- Modbus Serial to Modbus TCP router
- Modbus Serial or TCP to BACnet/IP gateway
- Modbus Master to Modbus TCP or serial slaves
- Certified Sedona Framework Controller®
- Power over Ethernet (PoE)
- Customisable webpages
- Web Services



Flexible Input/Output — expandable with the addition of expansion I/O modules

- Six universal input/output points web-page configurable
- Two relay outputs
- Thermistor, voltage, current, contact closure and pulse inputs
- Voltage, current and relay outputs
- 2-wire Modbus Serial expansion bus
- Expansion port for up to three expansion I/O modules

BASautomation®

BASremote Master — Versatile BACnet/IP Controller/Gateway

The BASremote Master provides the ultimate in flexibility. It can be used for expansion I/O at remote locations where an Ethernet connection exists. Its built-in router and gateway capabilities address unique integration needs where more than one communications protocol is involved. It can operate as a function block programmable controller with its resident Sedona Framework 1.2 virtual machine. Powered by a Linux engine, the BASremote Master can operate as BACnet/IP and Modbus TCP remote I/O, Sedona Framework controller, Modbus Serial to Modbus TCP router, Modbus Serial to BACnet gateway, and Modbus master to attached Modbus slaves all at the same time. A 10/100 Mbps Ethernet port allows connection to IP networks and popular building automation protocols such as Modbus TCP, BACnet/IP, and Sedona SOX. Six universal I/O points and two relay outputs can be configured through resident web pages using a standard web browser and without the need of

a special programming tool. A 2-wire Modbus serial port can greatly expand the I/O count with built-in routing to Modbus TCP clients. If BACnet mapping is preferred, the unit incorporates a Modbus serial to BACnet/IP gateway — capable of processing up to 1000 points. The BASremote Master also allows you to install custom web pages so you can view the status of your system in a convenient manner. And using its onboard Web Services, your IT department can easily interact with the BASremote Master.

Additional universal I/O can be achieved with the simple addition of BASremote Expansion modules. The BASremote PoE has the same capabilities as the BASremote Master except that it is powered over the Ethernet connection — thereby providing a “One Cable Solution”.

Universal I/O

Using web pages, six points can be configured as either inputs or outputs, analog or digital. In addition to being discoverable as BACnet objects, these same points can be assigned Modbus addresses.

- Analog inputs: 0–10 VDC, 0–20 mA but scalable to 0–5 VDC and 4–20 mA
- Temperature inputs: Type II or Type III thermistors
- Contact closure or Pulse inputs: Free-voltage, 40 Hz maximum
- Analog outputs: 0–10 VDC, 0–20 mA

All field connectors are removable.

Auxiliary Power Output

24 VDC @ 150 mA for powering field devices such as 4–20 mA transmitters.

Ethernet

10/100 Mbps Ethernet with auto-negotiation and Auto-MDIX. Protocols supported include HTTP, IP, UDP, TCP, SOAP, BACnet/IP, Modbus TCP, and Sedona SOX.

Power Input

24 VAC/VDC 17 VA half-wave regulated allows power sharing with other half-wave devices.

Modbus Serial Bus


RTU or ASCII master, 2.4–115.2 kbps, 2-wire non-isolated, up to 31 full-load EIA-485 devices

Expansion Port

Proprietary bus supporting up to three expansion modules requiring no configuration.

Relay Outputs

Two form “C” contacts for 30 VAC/VDC 2 A loads. Class 2 circuits only.

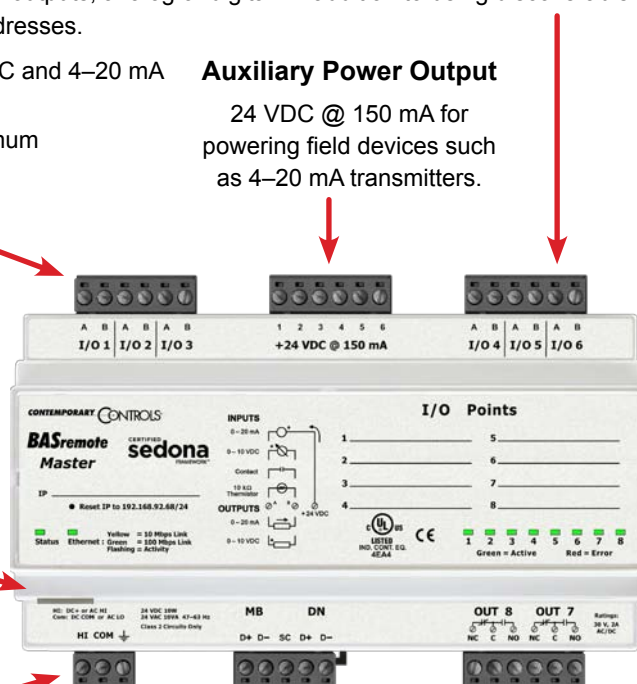

Some Common Components Used In Function Block Programming

The HVAC Group operations that facilitate control	LSeq	Linear Sequencer — bar graph representation of input value
	ReheatSeq	Reheat sequence — linear sequence up to four outputs
	Reset	Reset — output scales an input range between two limits
	Tstat	Thermostat — on/off temperature controller
The Scheduling Group scheduling operations based upon time of day	DailySc	Daily Schedule Boolean — two-period Boolean scheduler
	DailyS1	Daily Schedule Float — two-period float scheduler
	DateTime	Time of Day — time, day, month, year
	Cmpr	Comparison math — comparison (\leq , \geq) of two floats
	Count	Integer counter — up/down counter with integer output
	Freq	Pulse frequency — calculates the input pulse frequency
	Hysteresis	Hysteresis — setting on/off trip points to an input variable
	IRamp	IRamp — generates a repeating triangular wave with an integer output
	Limiter	Limiter — Restricts output within upper and lower bounds
	Linearize	Linearize — piecewise linearization of a float
	LP	LP — proportional, integral, derivative (PID) loop controller
	Ramp	Ramp — generates a repeating triangular or sawtooth wave with a float output
	SRLatch	Set/Reset Latch — single-bit data storage
	TickTock	Ticking clock — an astable oscillator used as a time base
	UpDn	Float counter — up/down counter with float output
The Priority Group prioritizing actions of Boolean, Float and Integer variables	PrioritizedBool	Prioritized boolean output — highest of sixteen inputs
	PrioritizedFloat	Prioritized float output — highest of sixteen inputs
	PrioritizedInt	Prioritized integer output — highest of sixteen inputs
	B2F	Binary to float encoder — 16-bit binary to float conversion
	ConstBool	Boolean constant — a predefined Boolean value
	ConstFloat	Float constant — a predefined float variable
	ConstInt	Integer constant — a predefined integer variable
	F2B	Float to binary decoder — float to 16-bit binary conversion
	F2I	Float to integer — float to integer conversion
	I2F	Integer to float — integer to float conversion
	WriteBool	Write Boolean — setting a writable Boolean value
	WriteFloat	Write Float — setting a writable float value
	WriteInt	Write integer — setting an integer value
	ADemux2	Analog Demux — Single-input, two-output analog de-multiplexer
	And2	Two-input Boolean product — two-input AND gate
	ASW	Analog switch — selection between two float variables
	ASW4	Analog switch — selection between four floats
	And4	Four-input Boolean product — four-input AND gate
	B2P	Binary to pulse — simple mono-stable oscillator (single-shot)
	BSW	Boolean switch — selection between two Boolean variables
	DemuxI2B4	Four-output Demux — integer to Boolean de-multiplexer
	ISW	Integer switch — selection between two integer variables
	Or2	Two-input Boolean sum — two-input OR gate
	Or4	Four-input Boolean sum — four-input OR gate
	Not	Not — inverts the state of a Boolean
	Xor	Two-input exclusive Boolean sum — two-input XOR gate
	DlyOff	Off delay timer — time delay from a “true” to “false” transition of the input
	DlyOn	On delay timer — time delay from an “false” to “true” transition of the input
	OneShot	Single Shot — provides an adjustable pulse width to an input transition
	Timer	Timer — countdown timer
	Add2	Two-input addition — results in the addition of two floats
	Add4	Four-input addition — results in the addition of four floats
	Avg10	Average of 10 — sums the last ten floats while dividing by ten thereby providing a running average
	AvgN	Average of N — sums the last N floats while dividing by N thereby providing a running average
	Div2	Divide two — results in the division of two float variables
	FloatOffset	Float offset — float shifted by a fixed amount
	Max	Maximum selector — selects the greater of two inputs
	Min	Minimum selector — selects the lesser of two inputs
	MinMax	Min/Max detector — records both the maximum and minimum values of a float
	Mul2	Multiply two — results in the multiplication of two floats
	Mul4	Multiply four — results in the multiplication of four floats
	Neg	Negate — changes the sign of a float
	Round	Round — rounds a float to the nearest N places
	Sub2	Subtract two — results in the subtraction of two floats
	Sub4	Subtract four — results in the subtraction of four floats
	TimeAvg	Time average — average value of float over time

Web Page Configuration

Web Server Screen

CONTEMPORARY CONTROLS

BAS Remote Web Configuration

Main Unit | Expansion Unit 1 | Expansion Unit 2 | Expansion Unit 3

Help | Visit our Website

Remote Configuration

I/O 1 | I/O 2 | I/O 3

I/O 4 | I/O 5 | I/O 6

CONTEMPORARY CONTROLS

BAS Remote Master

Status Ethernet

1 2 3 4 5 6 7 8

HI COM MB DN OUT 8 OUT 7

Map Configure Settings Modbus Utility Set Time

To configure the BAS Remote, click on any of the ports to adjust the I/O settings.

Key:

C

 - Configure

F

 - Force

For additional help, see the help section.

Current Settings

Unit Name : Master Unit

Modbus Address : 1

Bacnet Device Instance: 2431

Override LED Status

1 2 3 4 5 6 7 8

1

2

3

4

Channel Name

Analog Output

Analog

Present Value

5.25 V

7.5 V

5

Channel Name

10K Type3 THM

Binary I

Present Value

76.1 deg F

ON

©2004-2009 Contemp

Requires Java Runtime

CONTEMPORARY CONTROLS

BAS Remote

Help

Channel Type

INPUT: 0-20mA

Channel Name

Prod Floor Temp

BACNet Unit Group

Temperature

BACNet Unit Value

DEGREES_FAHRENH...

BACNet COV Increment

0

BACNet Description

SAVE

CANCEL

User Scaling

HIGH

20

92

VALUE

ACTUAL

SCALED

LOW

4

32

Typical I/O Point Configuration Screen

DS-BASR0000-BB0

Page 4


CONTEMPORARY CONTROLS

Powered by Sedona Framework for Implementing Control

The BASremote Master incorporates Sedona Virtual Machine (SVM) technology developed by Tridium and compatible with their Niagara Framework™. Using established Tridium tools such as Niagara Workbench or Sedona Workbench, a system integrator can develop a control application using Workbench's powerful drag-and-drop visual programming methodology. Once

developed, the program remains stored in the BASremote Master and executes by way of the SVM. The application can run standalone in the BASremote Master or interact with a program in a Tridium JACE supervisory controller over Ethernet. The number of potential applications is only limited by the imagination of the system integrator.

Tridium's Sedona Workbench or Niagara Workbench can be used to program Sedona running in the BAS Remote.

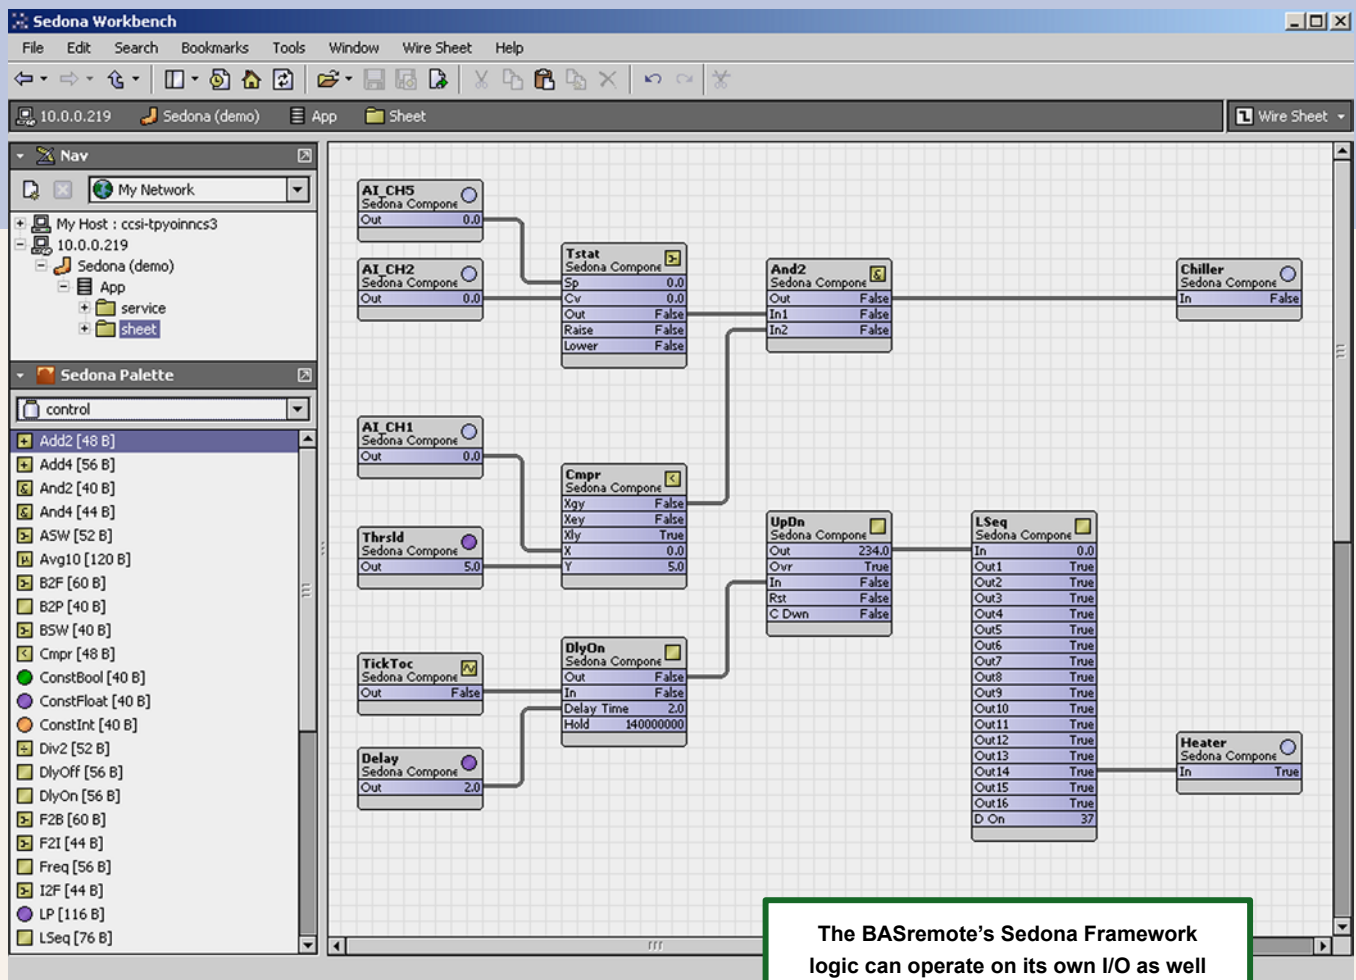

The BASremote's Sedona Framework logic can operate on its own I/O as well as that of connected Modbus Serial or TCP devices. Also, a network connected Niagara Framework device can read or modify the operating state of the Sedona Framework function blocks.

CERTIFIED
sedona
FRAMEWORK™

BACnet Protocol Implementation Conformance (PIC) Statement



BASremote

Versatile BACnet/IP Controller/Gateway



BACnet Protocol Implementation Conformance Statement (Annex A)

Date: August 12, 2013
Vendor Name: Contemporary Controls
Product Name: BASremote
Product Model Number: BASR-8M
Applications Software Version: 3.5.6 **Firmware Revision:** 3.5.6 **BACnet Protocol Revision:** 2
Product Description: BACnet/IP compliant 8-point Sedona Framework controller with Modbus Gateway.

BACnet Standardized Device Profile (Annex L):

- | | |
|-----------------------------------------------------------------------|------------------------------------------------------------------------------------|
| <input type="checkbox"/> BACnet Operator Workstation (B-OWS) | <input type="checkbox"/> BACnet Advanced Application Controller (B-AAC) |
| <input type="checkbox"/> BACnet Advanced Operator Workstation (B-AWS) | <input checked="" type="checkbox"/> BACnet Application Specific Controller (B-ASC) |
| <input type="checkbox"/> BACnet Operator Display (B-OD) | <input type="checkbox"/> BACnet Smart Sensor (B-SS) |
| <input type="checkbox"/> BACnet Building Controller (B-BC) | <input type="checkbox"/> BACnet Smart Actuator (B-SA) |

List all BACnet Interoperability Building Block Supported (Annex K):

DS-RP-B Data Sharing — ReadProperty — B	DM-DDB-B Device Management — Dynamic Device Binding — B
DS-WP-B Data Sharing — WriteProperty — B	DM-DOB-B Device Management — Dynamic Object Binding — B
DS-RPM-B Data Sharing — ReadPropertyMultiple — B	DM-DCC-B Device Management — Device Communication Control — B
DS-COV-B Data Sharing — ChangeOfValue — B	DM-TS-B Device Management — Time Synchronization — B

Segmentation Capability:

- | | |
|--------------------------------------------------------------|--------------|
| <input type="checkbox"/> Able to transmit segmented messages | Window Size: |
| <input type="checkbox"/> Able to receive segmented messages | Window Size: |

Standard Object Types Supported:

Object Type Supported	Can Be Created Dynamically	Can Be Deleted Dynamically
Analog Input	No	No
Analog Output	No	No
Analog Value	No	No
Binary Input	No	No
Binary Output	No	No
Device	No	No

No optional properties are supported.

Data Link Layer Options:

- | | |
|------------------------------------------------------------------------------|-----------------------------------------------------------------------------|
| <input checked="" type="checkbox"/> BACnet IP, (Annex J) | <input type="checkbox"/> MS/TP slave (Clause 9), baud rate(s): |
| <input checked="" type="checkbox"/> BACnet IP, (Annex J), Foreign Device | <input type="checkbox"/> Point-To-Point, EIA 232 (Clause 10), baud rate(s): |
| <input type="checkbox"/> ISO 8802-3, Ethernet (Clause 7) | <input type="checkbox"/> Point-To-Point, modem, (Clause 10), baud rate(s): |
| <input type="checkbox"/> ATA 878.1, 2.5 Mb. ARCNET (Clause 8) | <input type="checkbox"/> LonTalk, (Clause 11), medium: |
| <input type="checkbox"/> ATA 878.1, EIA-485 ARCNET (Clause 8), baud rate(s): | <input type="checkbox"/> BACnet/Zigbee (Annex O) |
| <input type="checkbox"/> MS/TP master (Clause 9), baud rate(s): | <input type="checkbox"/> Other: |

Device Address Binding:

Is static device binding supported? (This is currently necessary for two-way communication with MS/TP slaves and certain other devices.) ☐ Yes ☒ No

Networking Options:

- ☐ Router, Clause 6 – List all routing configurations, e.g., ARCNET-Ethernet-MS/TP, etc.
☐ Annex H, BACnet Tunnelling Router over IP
☐ BACnet/IP Broadcast Management Device (BBMD)
 Does the BBMD support registrations by Foreign Devices? ☐ Yes ☐ No
 Does the BBMD support network address translation? ☐ Yes ☐ No

Character Sets Supported:

- Indicating support for multiple character sets does not imply that they can all be supported simultaneously.
- | | | |
|-------------------------------------------------------|-----------------------------------------------|-------------------------------------|
| <input checked="" type="checkbox"/> ISO 10646 (UTF-8) | <input type="checkbox"/> IBM™/Microsoft™ DBCS | <input type="checkbox"/> ISO 8859-1 |
| <input type="checkbox"/> ISO 10646 (UCS-2) | <input type="checkbox"/> ISO 10646 (UCS-4) | <input type="checkbox"/> JIS X 0208 |

If this product is a communication gateway, describe the types of non-BACnet equipment/network(s) that the gateway supports:
Modbus gateway support.


Network Security Options:

- ☒ Non-secure Device — is capable of operating without BACnet Network Security
☐ Secure Device — is capable of using BACnet Network Security (NS-SD BIBB)
☐ Key Server (NS-KS BIBB)


August 12, 2013

TD040301-0XE

Wiring Diagram

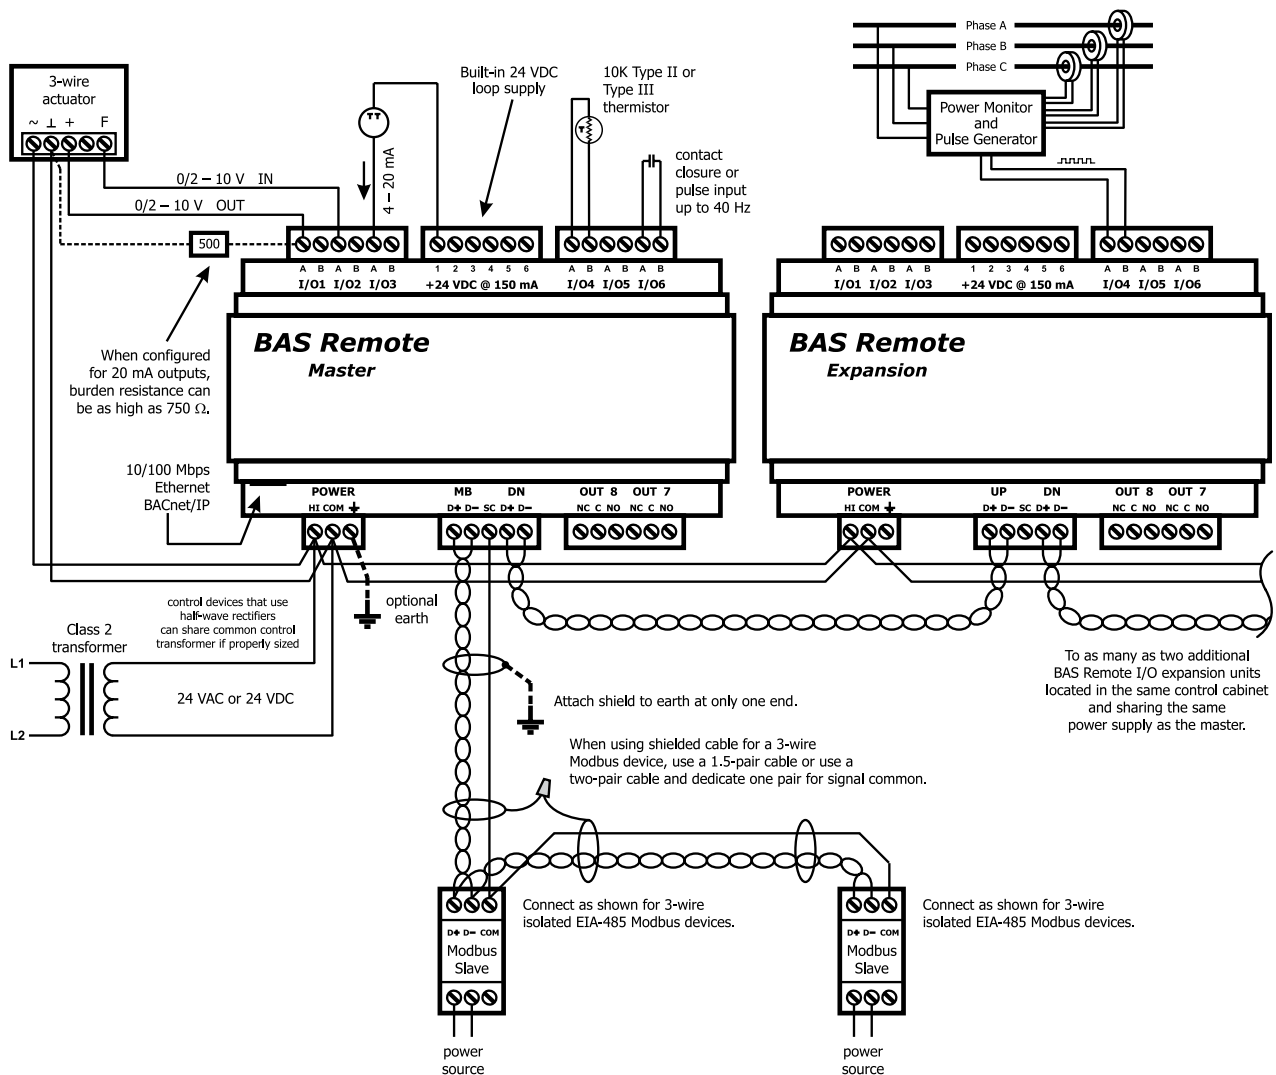

Dimensions (for all models)

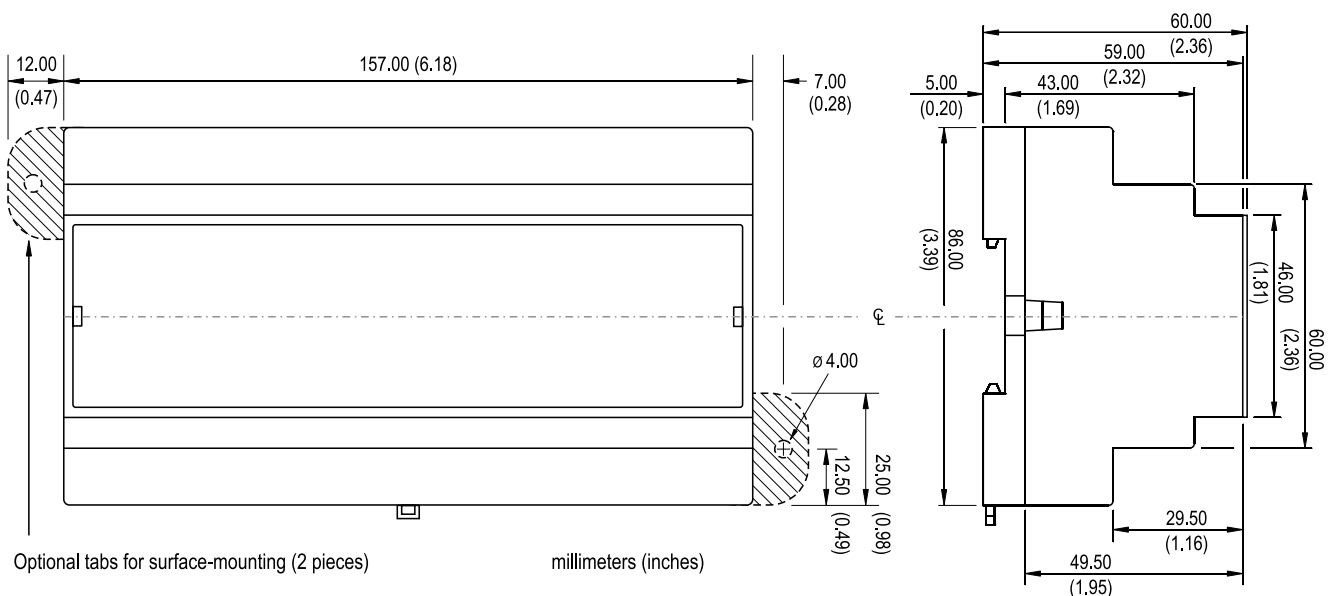

Specifications

Universal Inputs/Outputs (Channels 1–6)

Configured As

Analog input

Temperature input

Contact closure input

Pulse input

Analog output

Characteristics

0–10 VDC or 0–20 mA scalable by user. 10-bit resolution.

Input impedance 100 k Ω on voltage and 250 Ω on current.

Type II or type III thermistors +40°F to +110°F (+4.4°C to +44°C)

Excitation current 2 mA. Open circuit voltage 24 VDC.

Sensing threshold 0.3 VDC. Response time 20 ms.

0–10 VDC scalable by user. User adjustable threshold.

40 Hz maximum input frequency with 50% duty cycle.

0–10 VDC or 0–20 mA scalable by user. 12-bit resolution.

Maximum burden 750 Ohms when using current output.

Relay Outputs (Channels 7 and 8)

Form “C” contact with both NO and NC contacts. 30 VAC/VDC 2 A. Class 2 circuits only.

Regulatory Compliance

CE Mark; CFR 47, Part 15 Class A; RoHS; UL 508, C22.2 No. 142-M1987



Functional

Ethernet

Modbus Serial

Compliance

Protocols supported

Data rate

Physical layer

Cable length

Port connector

LEDs

Flow control

(BAS Remote Master Only)

IEEE 802.3

Modbus TCP

BACnet/IP

SOX

10 Mbps, 100 Mbps

10BASE-T, 100BASE-TX

100 m (max)

Shielded RJ-45

Green = 100 Mbps

Yellow = 10 Mbps

Flash = activity

Half-duplex (backpressure)

V1.02

RTU master

ASCII master

2.4 to 115.2 kbps

EIA-485, 2-wire, non-isolated

100 m (max)

3-pin terminal

Status green flashing = Modbus active

Electrical

Master

Expansion

Master/PoE

Input (DC or AC)

Voltage (V, \pm 10%)

Power

Frequency

Loop supply (24 VDC nom.)

DC

24

10 W

N/A

150 mA (max)

AC

24

17 VA

47–63 Hz

DC

24

8 W

N/A

150 mA (max)

AC

24

17 VA

47–63 Hz

DC

48

10 W

N/A

150 mA (max)

Environmental/Mechanical

Operating temperature

Storage temperature

Relative humidity

Protection

Weight

0°C to 60°C

–40°C to +85°C

10–95%, noncondensing

IP30

0.6 lbs. (.27 kg)

Specifications (continued)

RJ-45 Pin Assignments

MDI 10BASE-T/100BASE-TX

Terminal	Usage
1	TD +
2	TD –
3	RD +
6	RD –
Other pins	Not Used

Modbus (MB) Pin Assignments

Terminal	Usage
D +	Data +
D –	Data –
SC	Signal Common

Expansion Port (DN/UP) Pin Assignments

Terminal	Usage
D +	Data +
D –	Data –

Electromagnetic Compatibility

Standard	Test Method	Description	Test Levels
EN 55024	EN 61000-4-2	Electrostatic Discharge	6 kV contact & 8 kV air
EN 55024	EN 61000-4-3	Radiated Immunity	10 V/m, 80 MHz to 1 GHz
EN 55024	EN 61000-4-4	Fast Transient Burst	1 kV clamp & 2 kV direct
EN 55024	EN 61000-4-5	Voltage Surge	2 kV L-L & 2 kV L-Earth
EN 55024	EN 61000-4-6	Conducted Immunity	10 Volts (rms)
EN 55024	EN 61000-4-11	Voltage Dips & Interruptions	1 Line Cycle, 1 to 5 s @ 100% dip
EN 55022	CISPR 22	Radiated Emissions	Class A
EN 55022	CISPR 22	Conducted Emissions	Class B
CFR 47, Part 15	ANSI C63-4	Radiated Emissions	Class A

Ordering Information

Model	Description
BASR-8M	BAS Remote Master with 8 I/O points
BASR-8X	BAS Remote Expansion with 8 I/O points
BASR-8M/P	BAS Remote Master with 8 I/O points and PoE

United States

Contemporary Control Systems, Inc.
 2431 Curtiss Street
 Downers Grove, IL 60515
 USA

Tel: +1 630 963 7070
 Fax: +1 630 963 0109

info@ccontrols.com
www.ccontrols.com

China

Contemporary Controls (Suzhou) Co. Ltd
 11 Huoju Road
 Science & Technology Industrial Park
 New District, Suzhou
 PR China 215009

Tel: +86 512 68095866
 Fax: +86 512 68093760

info@ccontrols.com.cn
www.ccontrols.asia

United Kingdom

Contemporary Controls Ltd
 14 Bow Court
 Fletchworth Gate
 Coventry CV5 6SP
 United Kingdom

Tel: +44 (0)24 7641 3786
 Fax: +44 (0)24 7641 3923

info@ccontrols.co.uk
www.ccontrols.eu

Germany

Contemporary Controls GmbH
 Fuggerstraße 1 B
 04158 Leipzig
 Germany

Tel: +49 341 520359 0
 Fax: +49 341 520359 16

info@ccontrols.de
www.ccontrols.eu